



# Taktis **RESPONDING TO A FIRE ALARM**

This procedure should only be carried out by a suitably qualified person and, in the event of a Fire, should not be attempted by anyone except the Fire Brigade.

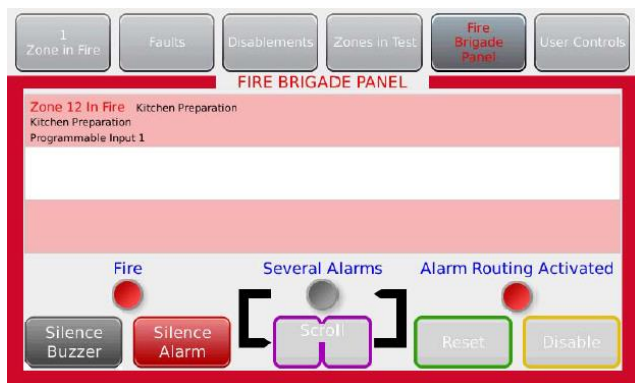

1 2

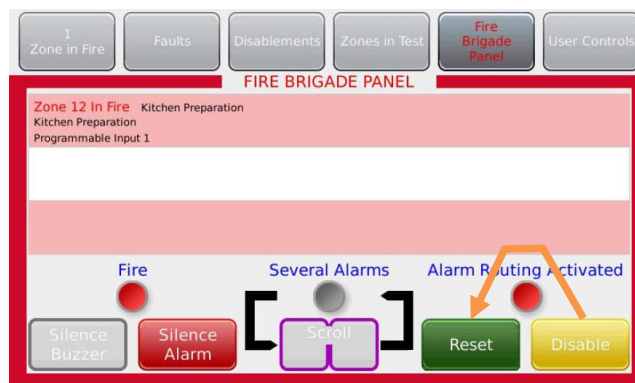

3 4

**1** Press -> **Silence Buzzer**  
This will silence the internal panel buzzer

**2** Once a suitably qualified person has investigated and determined the cause of the FIRE ALARM shown on the FIRE PANEL screen and you wish to proceed to cancel the Evacuation signals.

Press -> **Silence Alarm**  
This will silence ALL Sounders and Beacons where installed or, in the case of an EWIS system, will remove the trip from the EWIS panel. If the Silence Alarm button is pressed a second time the sounders will reactivate and you will need to silence them again before continuing to step 3 or 4.  
PLEASE NOTE: Wireless sounders may take up to 1 minute to silence, so please be patient.

**3** Once it has been deemed safe and you wish to reset the Fire Alarm as shown on the FIRE PANEL screen.

Press -> **Reset**  
This will Reset ALL current Fire Alarm conditions on the Fire Panel.

**4** If it has been determined an unwanted alarm (workmen in area, etc) or the same device reoffends after a reset (Step 3) and you wish to Disable the Device/Zone of the Fire Alarm and Reset the Fire Panel.

Press -> **Disable**  
Press -> **Reset**  
This will disable any device or the zone of the current Fire Alarm/s and reset ALL current Fire Alarm conditions on the Fire Panel.

After Step 2 you have 2 options, Step 3 or Step 4.